


ANNEX 4

Example of Packing and Marking for Category B Infectious Substances

(See Packing Instruction 650 for additional requirements, e.g. drop test)

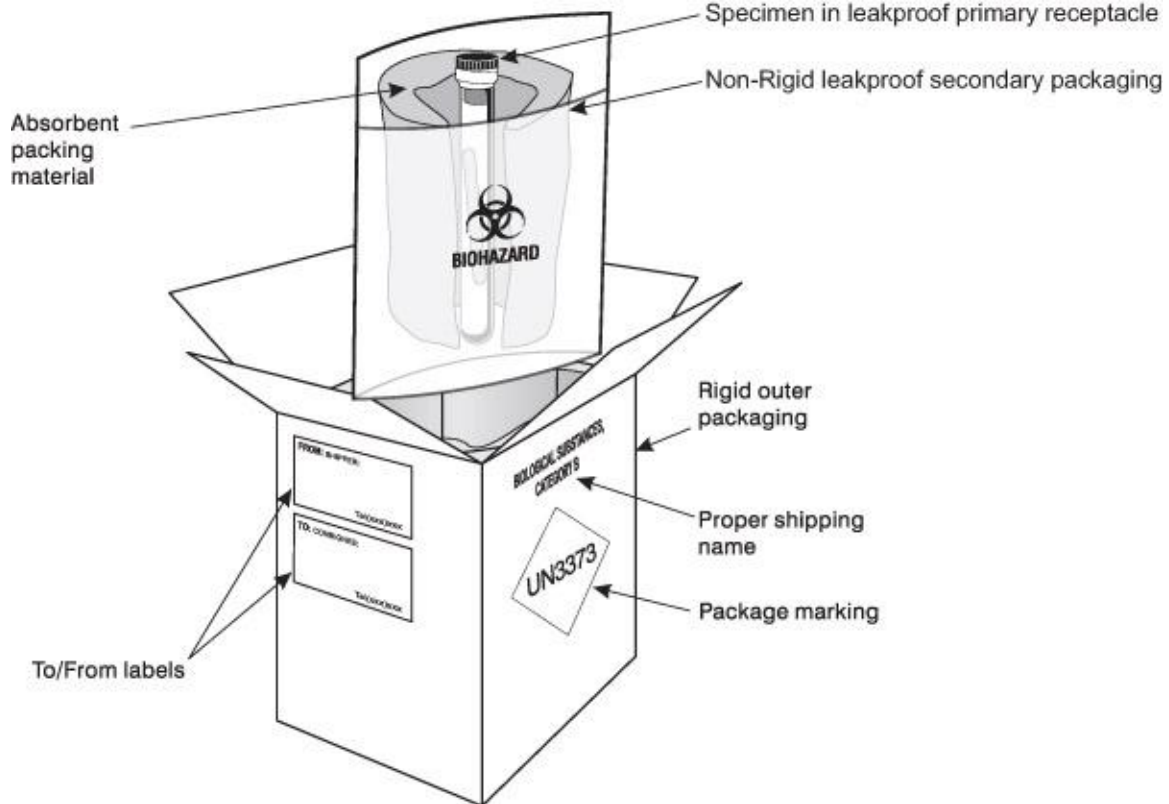

Notes:

1. At least one surface of the outer packaging must have a minimum dimension of 100 mm x 100 mm;
2. The primary receptacle or the secondary packaging must be capable of withstanding, without leakage, an internal pressure producing a pressure differential of not less than 95 kPa.